

REFRIGERATED COMPARTMENT WITH CONTROLLER  
TO PLACE REFRIGERATION SYSTEM IN SLEEP-MODE

Applicant: Micak et al.; Attorney Docket: 60246-347; Express Mail No. EV235994807US

1/3

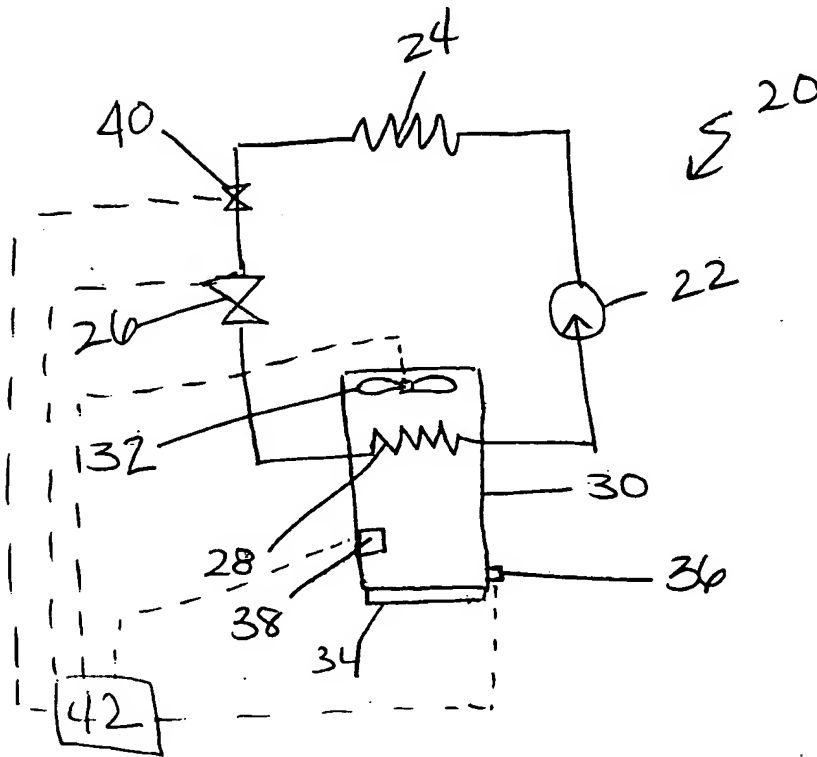


FIG. 1

Effect of Improper Shut-down and Start-up on Refrigeration Equipment with  
regard to kW Average

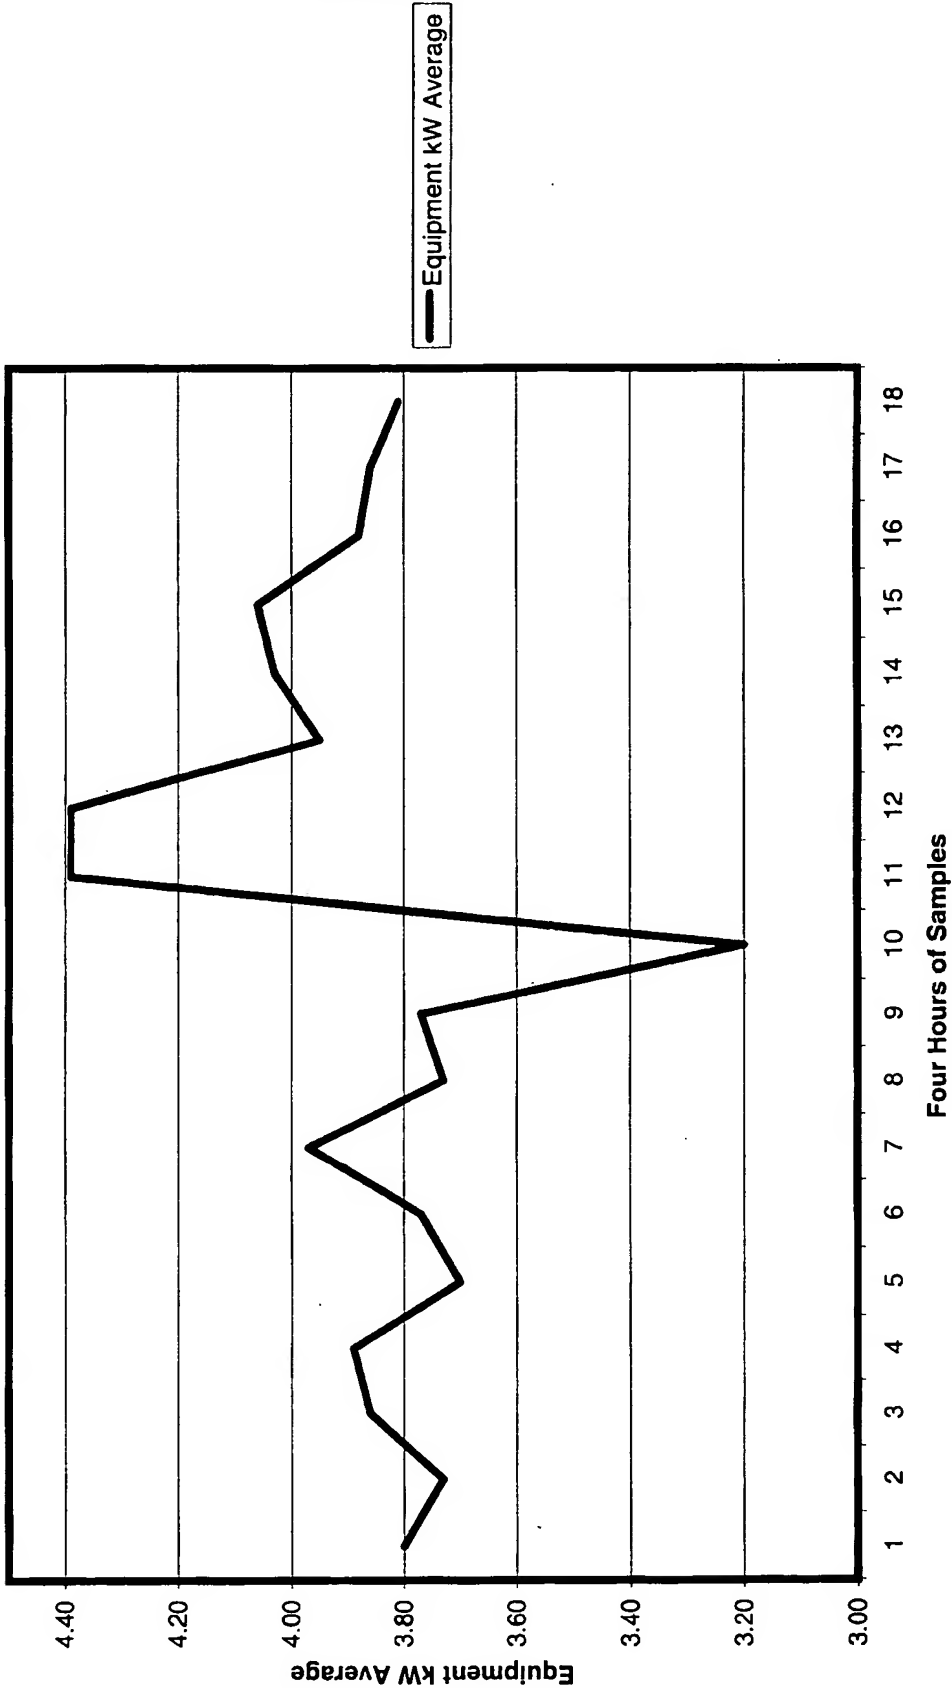


FIG. 2

Effect of Improper Shut-down and Start-up on Refrigeration Equipment with regard to freezer temperatures when evap shut-off switch was left off, and then turned back on.

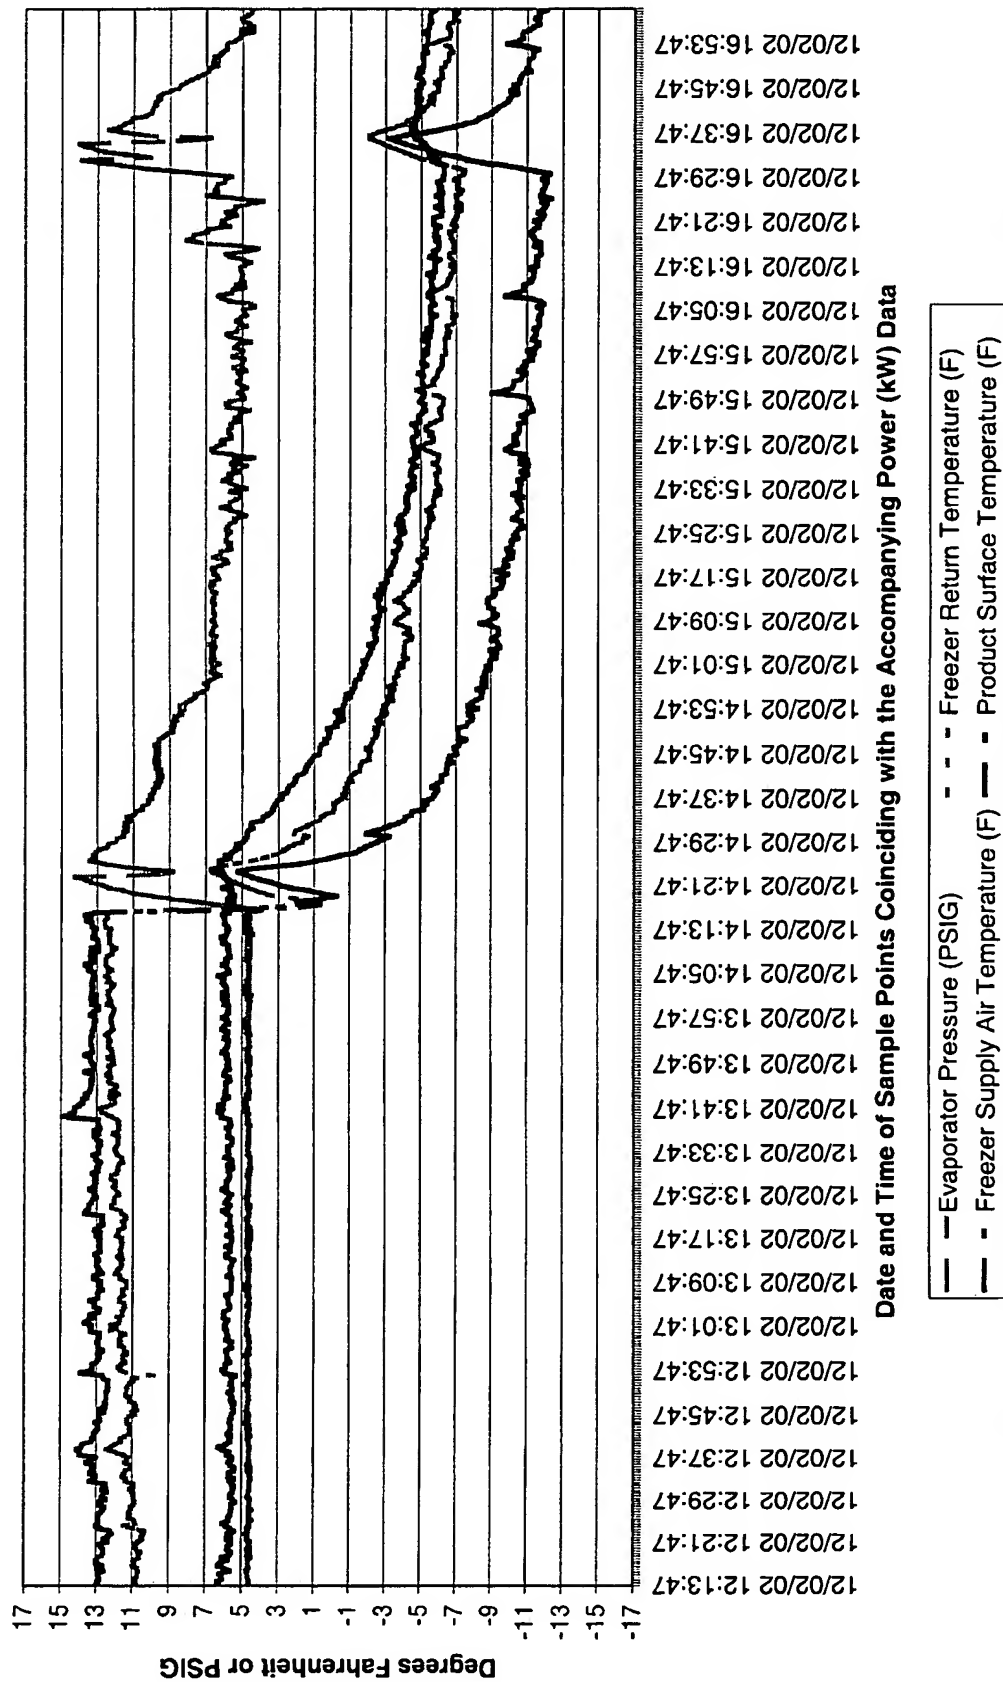


FIG. 3